


Betriebsausschuss 05.02.2008

- Information zu den aktuellen Nitratwerten -



- Information zu den aktuellen Nitratwerten [mg/l] -

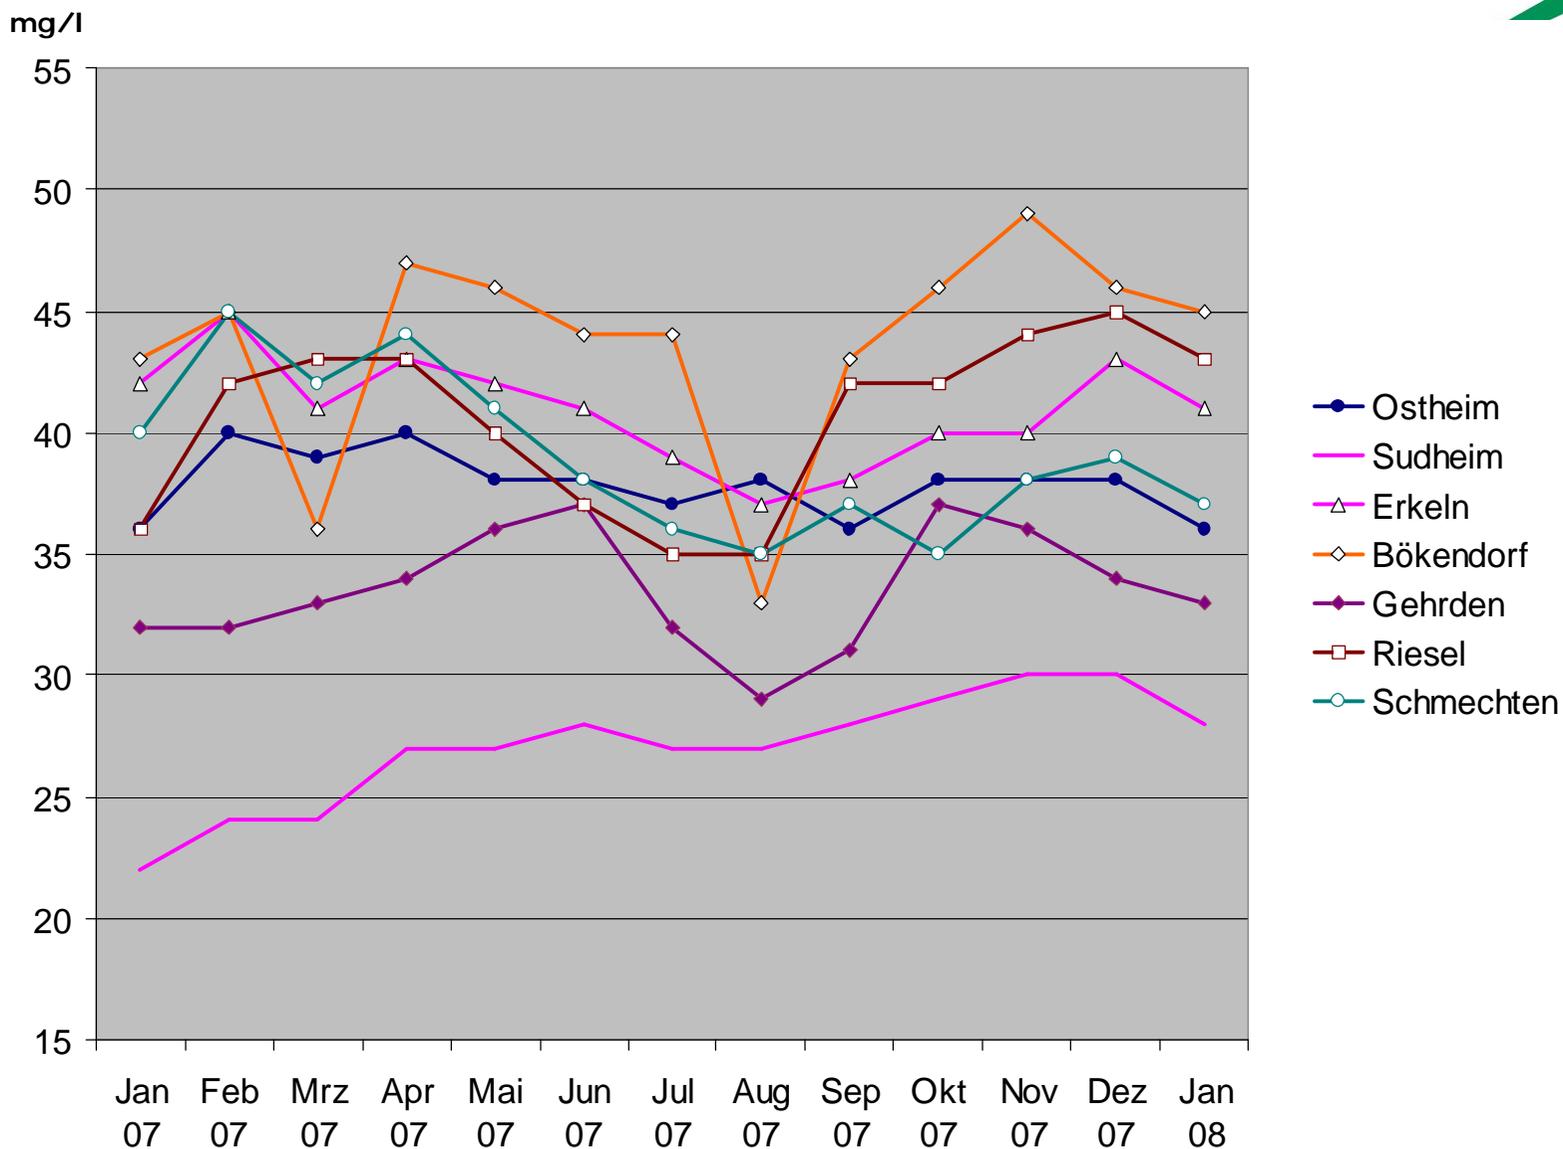


Probe entnommen am:	Wasserverk	Chem. U. Amt PB	Ostheim	Sudheim	Erkeln	Bökendorf	Gehrden	Riesel	Schmechten Brunnen	Schmechten Mischwasser
02.01.2006	X		40	24	45	45	34	40	45	43
06.02.2006	X		38	24	46	46	34	42	44	41
03.03.2006	X		38	27	48	46	36	43	42	42
31.03.2006	X		39	27	47	42	32	42	41	40
28.04.2006	X		39	27	43	45	29	40	40	41
03.05.2006		X	37	26	41	43	34	40	37	
02.06.2006	X		36	26	40	44	33	38	32	37
30.06.2006	X		36	25	39	43	32	32	37	34
02.08.2006	X		34	28	38	44	33	34	37	35
01.09.2006	X		38	27	40	45	33	34	42	38
29.09.2006	X		38	26	41	44	31	34	44	39
04.10.2006		X	38	25	41	45	31	34	25	
03.11.2006	X		37	28	42	-	30	33	41	38
04.12.2006	X		37	24	43	44	31	35	47	42
29.12.2006	X		36	22	42	43	32	36	32	40
02.02.2007	X		40	24	45	45	32	42	47	45
02.03.2007	X		39	24	41	36	33	43	44	42
30.03.2007	X		40	27	43	47	34	43	48	44
02.05.2007	X		38	27	42	46	36	40	36	41
23.05.2007		X	39	27	40	48	38	39	32	
01.06.2007	X		38	28	41	44	37	37	42	38
29.06.2007	X		37	27	39	44	32	35	40	36
01.08.2007	X		38	27	37	33	29	35	40	35
31.08.2007	X		36	28	38	43	31	42	41	37
28.09.2007	X		38	29	40	46	37	42	42	35
02.11.2007	X		38	30	40	49	36	44	39	38
13.11.2007		X	38	29	39	47	36	42	27	
30.11.2007	X		38	30	43	46	34	45	40	39
03.01.2008	X		36	28	41	45	33	43	39	37

Übersicht Nitrat-Statistik:
(seit 1997)

Max	47	42	55	51	56	54	63	49
Min	33	21	34	33	26	29	16	34
Mittel	41	29	44	45	39	41	43	41
Messungen	150	150	153	158	156	161	159	72

Betriebsausschuss 05.02.2008

Niederschlagsmengen 2003 bis 2007

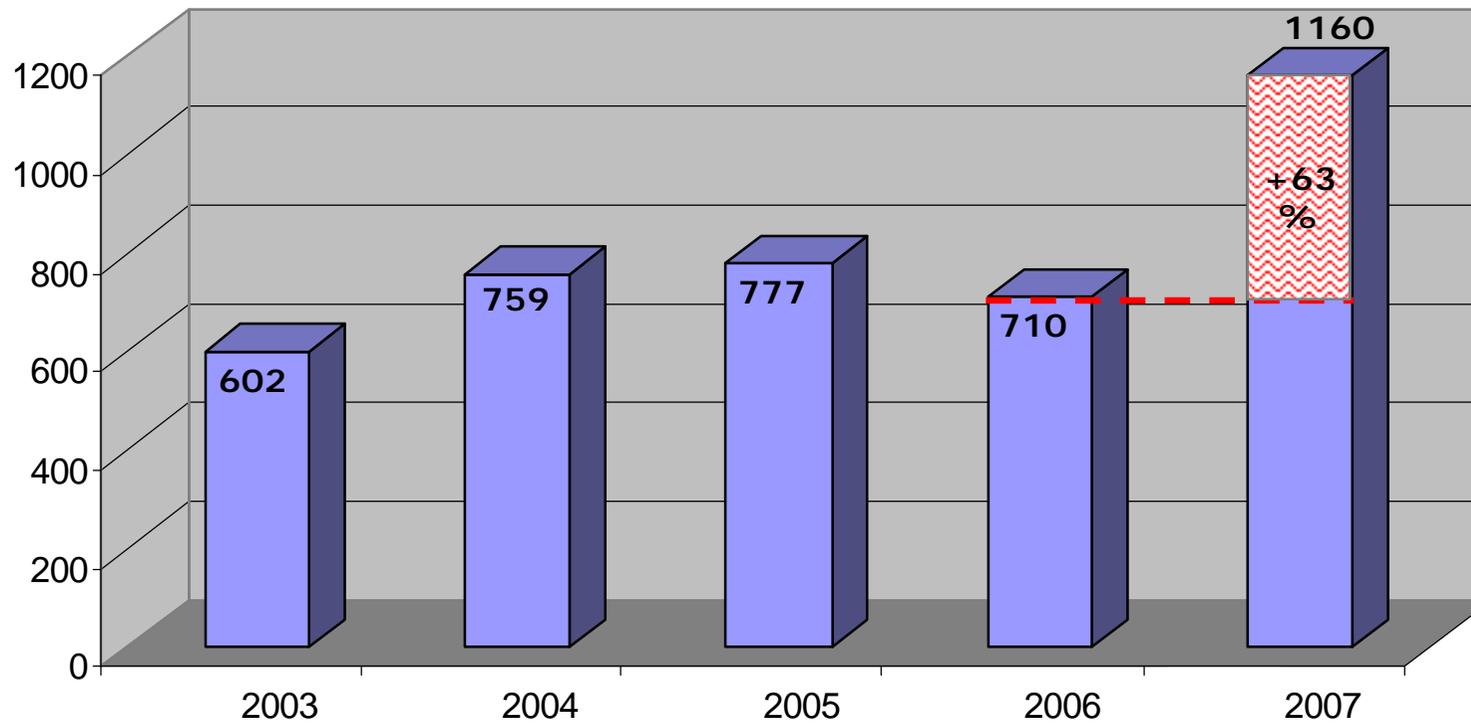

gemessen auf dem Gelände der Kläranlage Brakel